
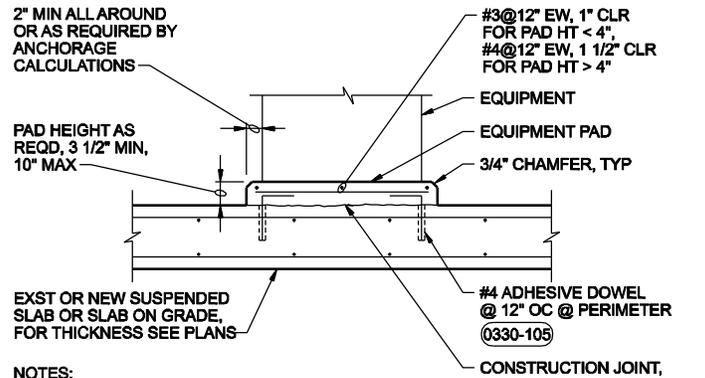


NOTE:
 DIM X= 1'-0" MIN OR AS REQD BY PUMP MANUFACTURER

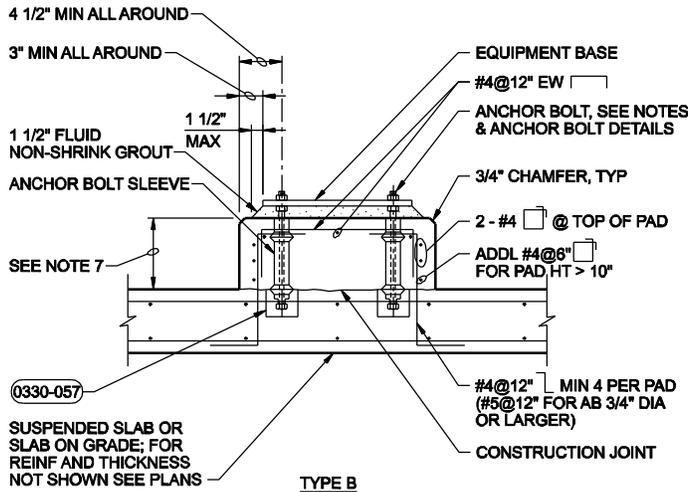

- NOTES:
1. WHEN ANCHORAGE OF EQUIPMENT TO PAD IS REQUIRED, USE CONCRETE ANCHORS SPECIFIED.
 2. CONCRETE PADS FOR ELECTRICAL EQUIPMENT SHALL BE 3 1/2" HIGH, UNLESS NOTED OTHERWISE.

CONCRETE EQUIPMENT PADS (1 OF 2)

NTS

EASTERN MUNICIPAL WATER DISTRICT
 PERRIS II DESALINATION FACILITY

DETAIL 1 OF 2

0330-056