

SET COVER OF VALVE BOX AND CONC PAD 1/4" BELOW GRADE IN PAVEMENT OR SHOULDER, AND FLUSH WITH GRADE ELSEWHERE

CAST IRON LID

PROVIDE 1'-6" SQ x 4" THICK CONC PAD

FINISHED GRADE

COMPACTED BACKFILL

CAST IRON VALVE BOX, SLIDING TYPE, UPPER SECTION


6" MIN

CAST IRON VALVE BOX LOWER SECTION

EXTENSION ROD REQD W/ 2" OPERATING NUT 1'-0" BELOW GRADE WHEN VALVE IS OVER 3'-0" BELOW GRADE

GATE VALVE

VALVE SIZE AND ENDS AS SPECIFIED OR INDICATED ON PLANS

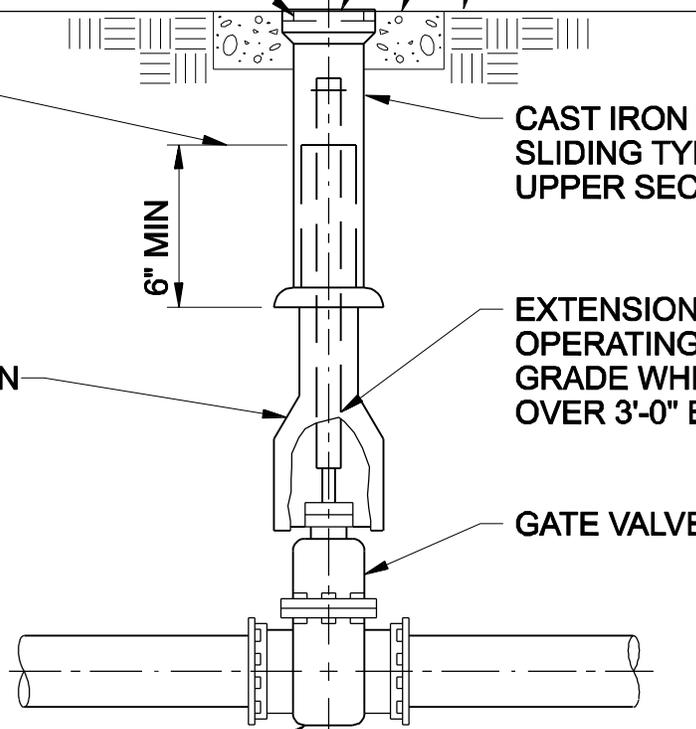

# BURIED GATE VALVE BOX

NTS

© CH2M HILL